

Development of water demand coefficients for power generation from renewable energy technologies

Babkir Ali and Amit Kumar¹

Donadeo Innovation Centre for Engineering, Department of Mechanical Engineering, University of Alberta, Edmonton, Alberta T6G 1H9, Canada

Abstract

Renewable energy technology-based power generation is considered to be environmentally friendly and to have a low life cycle greenhouse gas emissions footprint. However, the life cycle water footprint of renewable energy technology-based power generation needs to be assessed. The objective of this study is to develop life cycle water footprints for renewable energy technology-based power generation pathways. Water demand is evaluated through consumption and withdrawals coefficients developed in this study. Sixty renewable energy technology-based power generation pathways were developed for a comprehensive comparative assessment of water footprints. The pathways were based on the use of biomass, nuclear, solar, wind, hydroelectricity, and geothermal as the source of energy. During the complete life cycle, power generation from bio-oil extracted from wood chips, a biomass source, was found to have the highest water demand footprint and wind power the lowest. During the complete life cycle, the water demand coefficients for biomass-based power generation pathways range from 260 – 1289 litres of water per kilowatt hour and for nuclear energy pathways from 0.48 – 179 litres of water per kilowatt hour. The water demand for power generation from solar energy-based pathways ranges from 0.02 – 4.39 litres of water per kilowatt hour, for geothermal pathways from 0.04 – 1.94 litres of water per kilowatt hour, and for wind from 0.005 – 0.104 litres of water per kilowatt hour. A sensitivity analysis was conducted with varying conversion efficiencies to evaluate the impact of power plant performance on water demand. Cooling systems used in power generation plants were also studied and include once-through, recirculating, dry, and hybrid cooling. When only the power generation stage is considered, hydroelectricity and nuclear

¹ Corresponding Author. Tel.: +1-780-492-7797.

E-mail address: Amit.Kumar@ualberta.ca (A. Kumar).

power generation with once-through cooling systems showed the highest water consumption (68 litres of water per kilowatt hour) and water withdrawals coefficients (178 litres of water per kilowatt hour), respectively.

Keywords: Water-energy nexus; life cycle; water footprint; sustainability; renewable energy; power generation

1. Introduction

Natural resource use needs to be balanced with electricity demand in such a way that an acceptable level of sustainability is maintained. Most of the focus to this point has been on the mitigation of greenhouse gas (GHG) emissions, and water use in electricity production has received little attention. As part of maintaining a sustainable balance, the quantity and quality of water, a precious natural resource, have to be managed. Cooling systems, as one of the unit operations for thermoelectric power generation, consume large amounts of water through evaporation and are of great concern in terms of water use efficiency [1]. A sustainable energy pathway would reduce the environmental footprint, and water is one of the targeted natural resources to be conserved [2]. Renewable energy technologies (RETs) are proposed as a critical aspect of the water, energy, and food nexus [3]. There is evidence around the world showing how water availability has played a key role in decisions related to power generation. For example, following the 2006 - 2007 drought in the U.S. and in France in 2003, some coal and nuclear power plants were shut down or are now operating at reduced capacity [4]. The use of renewable energy through improved technologies is expected to have a major role in the future of sustainable energy [5]. The contribution to electricity generation from renewable energy is expected to increase in the U.S. from 13% of the total energy in 2013 to 18% by 2040 [6].

Electricity generation consumes considerable amounts of water during the generation of power during cooling, steam cycle, make-up, cleaning, and fuel life cycle activities. Shale gas is one of the promising fuels for electricity generation and its fuel life cycle stage has environmental concerns due to the huge amounts of water required for hydraulic fracturing [7]. In 2005,

thermoelectric power plants withdrew 41% of the total fresh water required in the U.S. with a consumption rate of 3%, and the water use for some renewable energy sources may exceed that of conventional technologies [8]. Thermoelectric power plants in Canada, including nuclear, withdrew about 27.8 million m³ of water in 2005, or 66% of the total water withdrawals, and in the same year hydroelectric power used more than 100 times that amount [9]. Renewable energy has been proposed as a clean, alternative solution to conventional resources from a GHG mitigation point of view. The complete life cycle analysis of nine power generation technologies showed that renewable energy can significantly mitigate GHG emissions [10]. Power generation based on the complete life cycle of nuclear energy has average GHG emissions intensity, in the same range as biomass, hydroelectricity, and wind; this intensity is 7% and 3% of the corresponding values for natural gas and coal-fired power plants, respectively [11]. Direct combustion of biomass to generate power can mitigate up to 1257 g CO₂-eq/kWh compared to the GHG intensity of coal-fired power generation [12], and, based on this same reference, solar thermal power generation can mitigate up to 647 g CO₂-eq/kWh [13].

The use of water for renewable energy has been studied earlier with a focus on the power generation stage and not on life cycle water consumption. Moreover, most of these studies do not assess the effects of conversion efficiencies on water demand coefficients. Water demand coefficients for evaporation from biomass and nuclear power plant cooling systems were estimated and compared with the corresponding conventional thermal power plants without considering the impact of conversion efficiency on estimated water use [14]. Meldrum et al. [15] harmonized water demand coefficients based on earlier studies such as those by Fthenakis and Kim [16] and Wilson et al. [17] for a wide range of power generation technologies over the complete life cycle with a fixed value conversion efficiency value; uncertainty in the variation of water demand coefficients with different levels of power plants performance was not discussed. Fthenakis and Kim [16] reviewed water use for conventional and renewable energy-based power generation and highlighted the necessity of developing complete life cycle analysis with transparent and balanced approach criteria. Although of the fact that all RETs can mitigate GHG emissions, but this is not the case for water conservation as some of these technologies such as hydroelectricity and biomass have negative impact on water use[17] Water consumption coefficients for the complete life cycle of power generation from different biomass pathways

[18] and different renewable energy technologies [19] were developed at a specific conversion efficiency, but the associated water withdrawals coefficients were not included. Water demand coefficients for thermoelectric and hydroelectric power plants were used to estimate the water intensity for hydrogen production with a focus on the cooling system unit operations, yet other stages of the complete life cycle were not included [20]. Comprehensive sustainability indicators were developed for a comparative assessment of power generation technologies, and water demand indicators were represented through fresh water consumption without considering water withdrawals coefficients [21]. Water demand coefficients include both the water consumption coefficient and the water withdrawals coefficient for each pathway and are one of the well-established indicators for water use by power generation plants. Water consumption is the amount of water consumed by the unit operations of the process and not returned back to the source, while water withdrawals include water returned to the source apart from consumption. Water consumption and water withdrawals coefficients were developed in earlier studies for gas-fired [22] and for coal-based power generation [23] to cover the complete life cycle of fuel extraction and power generation stage. Since renewable technologies are still at various stages of development and demonstration, there needs to be a life cycle approach to understand the full impacts of the technologies. In addition, there is good potential for conversion efficiency improvement in the power generation technologies, and the potential can be better understood by assessing their impacts. There is little research that comparatively assesses life cycle water consumption coefficients for different renewable energy pathways. Tan and Zhi [24] highlighted the lack of studies on the water-energy nexus for solar, wind, and geothermal technologies and recommended future research be conducted in this field. This study is an effort to fill that gap and its novelty is that it includes sixty pathways of power generation based on the complete life cycle of renewable energy technologies and identifies the uncertainty in water demand coefficients from variations in the conversion efficiency of the power plants. This study is different from earlier similar studies by the authors [22, 23] in that it investigates the sustainability of renewable energy technologies and compares them with fossil fuel-based power generation with a different view of water use along with the already well-considered view of GHG emissions.

The main objectives of this paper are to:

- Develop water demand coefficients for renewable energy technologies over the complete life cycle of power generation from biomass, nuclear, solar, wind, hydroelectricity, and geothermal,
- Comparatively assess the upstream and power generation stages of the water demand coefficients for various renewable energy technologies,
- Comparatively assess the water demand of sixty different pathways in the conversion of renewable energy to power; and
- Assess the impact of conversion efficiency on water use for renewable energy pathways through a comprehensive uncertainty analysis.

2. Scope and system boundary

Pathways were structured specific to renewable energy sources (see Figure 1). The main unit operations considered for water demand coefficients during the entire life cycle are fuel extraction (if any), conversion technology for power generation, and the cooling system (if any). For the base case, the specific conversion efficiency of power plants was assumed and impacts of variations were studied later in the sensitivity analysis. This base case conversion efficiency was taken as the most likely value in a model executed through Monte Carlo simulations [25-28]. The most likely value is bound by minimum and maximum efficiencies to study the uncertainty of the assumed values [22].

Two sets of water demand coefficients were developed and further harmonized at certain conversion efficiencies. The first set of developed coefficients covers the complete life cycle of the pathway and the second set is limited to unit operations for power generation. The conversion efficiency was varied in the sensitivity analysis to study the effect of power plant performance on the water demand coefficient levels.

The water consumption coefficient (WCUP) and the water withdrawals coefficient (WWUP) in the upstream stage are correlated to the conversion efficiency (η) through the factors of merit M1 and M2, respectively, as follows (as taken from a previous study conducted by the authors [23]):

$$\mathbf{WCUP = M1 * (1/ \eta)} \quad \mathbf{(1)}$$

$$\mathbf{WWUP = M2 * (1/ \eta)} \quad \mathbf{(2)}$$

Factors of merit are constant coefficients in L/kWh assigned to differentiate between the water demand coefficients of pathways from the same set. The lower the factor of merit, the better the performance of a pathway with respect to the water demand coefficient.

There are two types of correlations between water demand coefficients and conversion efficiencies (η) identified in this paper for the power generation stage. The first type includes all renewable energy technologies that use a steam cycle to generate electricity (thermoelectric), as shown in Figure 2. These technologies cover all biomass, nuclear, solar-thermal, and geothermal pathways and are governed by the factors of merit M3 for the water consumption coefficient (WCC) and M4 for the water withdrawals coefficient (WWC) (based on an earlier study [23]), as follows:

$$\mathbf{WCC} = \mathbf{M3} * ((\mathbf{1}/\eta) - \mathbf{1}) \quad (3)$$

$$\mathbf{WWC} = \mathbf{M4} * ((\mathbf{1}/\eta) - \mathbf{1}) \quad (4)$$

The second set of factors of merit, M5 and M6, is assigned to the rest of the technologies (wind, hydroelectricity, and solar-photovoltaic as shown in Figure 3) to correlate the conversion efficiency (η) to the water consumption coefficient (WCC) and water withdrawals coefficient (WWC), respectively, as follows:

$$\mathbf{WCC} = \mathbf{M5} * (\mathbf{1}/\eta) \quad (5)$$

$$\mathbf{WWC} = \mathbf{M6} * (\mathbf{1}/\eta) \quad (6)$$

The six factors of merit (M1-M6) were determined from the base case values of water demand coefficients and the associated conversion efficiency.

2.1 Pathway descriptions

Six types of power generation from renewable energy sources were selected: biomass, nuclear, solar, wind, hydroelectricity, and geothermal. Biomass and nuclear are the principle renewable sources although some other sources such as municipal solid waste, wastewater treatment sludge, and short rotation forestry are not considered in this study. Cooling systems (once-through, cooling tower, cooling pond, and dry cooling) were considered for the biomass, solar-thermal, nuclear, and geothermal power generation pathways [29, 30]. Hybrid cooling was considered for the solar-thermal pathways (power tower and parabolic trough) as well as the geothermal energy-based pathways using binary technology [15].

2.1.1 Biomass pathways

Biomass pathways were subdivided by fuel into direct or bio-oil combustion of one of four feedstocks (switchgrass, corn stover, wheat straw, and wood chips) [18, 31]. Direct combustion burns biomass feedstock in a boiler to produce steam, and power is generated in a Rankine cycle. The power generation unit operations in this case are similar to those for coal-fired power generation. In the other combustion method, bio-oil is produced through pyrolysis and combusted as fuel to generate power. The agricultural stage for both biomass technologies (direct combustion and bio-oil combustion) and the conversion stage for bio-oil pathways were added to the upstream unit operations (see Figure 2). Further details can be found in earlier studies [18, 31].

Other pathways of biomass-based power generation such as gasification [32] and co-firing [33] are not considered in this paper, and the technologies (direct combustion and bio-oil combustion) are considered as target cases.

2.1.2 Nuclear pathways

Nuclear energy is one of the most cost-effective energy sources and considered in the current study as one of the renewable energy technologies [34]. Nuclear fuel pathways consider fuel enrichment by diffusion or centrifugally [10, 15]. Laser enrichment is a technology used to enrich uranium but is not available commercially, and nuclear power plants use uranium U-235 that has been enriched from 0.7% content raw uranium (the remaining 99.3% is U-238) to a range of 3%-5% [35, 36]. Nuclear power generation in Korea is expanding because it costs less

than other fossil fuel-based power and nuclear plants can be located in remote coastal areas for safety and easy access of cooling water [37].

The upstream stage of nuclear power generation includes extraction, grinding, conversion, enrichment, and plant construction. The power generation stage includes cooling systems, steam make-up, fuel disposal, and power plant construction and decommissioning (see Figure 2).

2.1.3 Solar pathways

Solar energy power generation technologies include solar-thermal and photovoltaic. Solar-thermal technologies include power tower, parabolic trough, Fresnel lens, and dish systems [38, 39]. Photovoltaic systems can be made by thin film or crystalline silicon (C-Si) and the modes of operation are flat panelled or concentrated photovoltaic (PV).

Solar-thermal technology generates power through concentrating sun rays to heat a medium fluid that rotates a turbine and a generator. The shape of solar collectors varies depending on the technology. The power tower has heliostats to reflect the incoming sun rays into a tower carrying the central receiver. The concentrated sun rays heat the fluid in the central receiver and the kinetic energy of this fluid is converted to mechanical and electric energy through the turbine and the generator. Parabolic trough technology focuses the sun's rays on a linear receiver (pipe) to heat the fluid and generate power. In Fresnel lens technology, curved mirrors reflect the sun's rays onto a linear receiver to generate power. A parabolic dish concentrates the sun's rays on a focal point (a receiver and a Sterling engine) to generate power [40, 41]. A more detailed description of solar thermal technologies can be found in a comprehensive review by Zhang et al. [42].

A thin film photovoltaic module has two semiconductors, cadmium telluride (CdTe or CuInSe_2) and cadmium sulfide (CDS), which make up a p-n junction. CdTe and CDS are deposited in thin layers onto a transparent glass panel [43]. A crystalline silicon (C-Si) module is manufactured by purifying silica sand into metallurgical grade silicon (MG-silicon) and then to electronic silicon (EG-silicon). The silicon is melted and cast in molds into polycrystalline blocks to produce multi-silicon wafers. Etching, doping, screen printing, coating, and testing are the main steps involved in finalizing the product. An aluminium frame is added to support the manufactured

photovoltaic panel. Laminated panels do not need this frame [44]. The performance of PV panels has improved and the production costs have been drastically reduced so that they can compete with other power generation pathways. Solar is third after hydroelectricity and wind of the total installed capacity of renewable energy in the world [45].

The operation of solar-thermal technologies needs water for cooling, and the water demand for materials extraction, manufacturing, and construction of the systems is included in the upstream stage (see Figure 2).

Photovoltaic power generation requires minimal water during operation, for panel washing, and no cooling system is needed (see Figure 3).

2.1.4 Wind and hydroelectricity pathways

Wind is created by the difference in ambient temperature initiated from the sun's heat. Wind turbines are mounted on a tower to convert the kinetic energy of wind into mechanical and then electric energy through a generator [46]. Wind energy is one of the fastest-growing power generation technologies in the world [47, 48] and can be installed on dry land or offshore on wet surfaces such as sea or fresh water [49]. The total wind power capacity in the world by the end of 2015 was 433 GW, with more than half (248 GW) installed in three countries, China (30%), the U.S. (17%), and Germany (10%) [50]. Power generation operations from wind energy do not require cooling systems (see Figure 3), and minimal water is required (for cleaning the turbines and for construction during the upstream stage).

Hydroelectricity originates from moving water, which converts kinetic energy to mechanical energy through a turbine and then to electric energy through a generator. Some hydropower plants are located in the running stream of water (run-of-river), and for high power production scales, dams are constructed to increase the height (head) of the falling water. Reservoirs are constructed with dams to store water for other uses and to help control the amount of running water through the penstock to the turbine [51]. In 2014, more than 16% of the total power generated in the world was from hydroelectricity [50, 52]. Interconnections and hybrid systems are used to balance supply and demand sides of electricity. Skagerrak 4 is an interconnection

project that has been operating since 2015 to balance hydroelectricity generation in Norway with wind and thermal power generation in Denmark, and Longyangxia is a hybrid project in China to mix 1280 MW from hydroelectricity and 850 MW from solar PV [50]. Hydroelectricity operations consume significant amounts of water through evaporation from the reservoir. Water demand during the upstream stage is for hydropower plant construction (see Figure 3).

2.1.5 Geothermal pathways

Geothermal pathways include binary, flash, and enhanced geothermal system (EGS) technologies. Binary technology operates at a low temperature (85°C - 175°C) and uses geothermal liquid to heat through the exchanger an intermediate working fluid (such as isobutene) at a boiling point that is lower still. The kinetic energy of the heated working fluid is converted to mechanical energy to rotate the turbine, which is coupled to the electric generator, for power generation [53, 54]. Geothermal flash is the most common geothermal power generation technology; in this system, a mixture of water and steam produced from the reservoir is flashed in a separate tank at low pressure. The steam is separated and used to generate electricity; the water not flashed is returned to the geothermal reservoir through an injection well [53-56]. In EGS technology, water as a working fluid is circulated in a closed loop through the injection well to rocks and pumped out through a production well. Circulated water is heated to the steam phase to run the turbine and generate power [57]. The total installed capacity of geothermal power generation in the world in 2015 was 12635 MW with the largest share from the U.S. (27%), followed by the Philippines (15%), Mexico (8%), and New Zealand (8%) [58]. 79% of the installed capacity in the U.S. is from the Geysers and Imperial Valley in California State. Chena Hot Springs in Alaska operates through binary technology with 74°C the lowest temperature, and a hybrid power plant is located in Nevada, at Stillwater, with mixed sources of geothermal, solar PV, and solar thermal power generation. The cooling system is the most critical unit operation determining the level of water demand during the power generation stage of geothermal pathways (see Figure 2).

3. Assumptions and input data

Water demand coefficients for the various unit operations were developed and integrated to estimate the overall life cycle water footprint. The estimates were further harmonized at the most likely conversion efficiencies assumed in the base case. Table 1 shows the most likely, minimum, and maximum efficiencies considered in this study.

Coefficients for the power generation stage from biomass pathways were derived from an earlier work by the authors [23]. The complete life cycle water demand coefficients for agricultural biomass feedstocks (switchgrass, corn stover, and wheat straw) were estimated after taking into account fuel production stage data taken from an earlier study [18]. Forest biomass-based power was estimated based on Canadian pine tree characteristics [59-61]. Table 2 shows the input data used to develop water demand coefficients for biomass pathways. Input data for nuclear pathways are shown in Table 3; solar-thermal and geothermal pathways are shown in Table 4; and Table 5 gives input data for photovoltaic, wind, and hydroelectricity pathways.

4. Results and discussion

Table 6 shows the developed generic water demand coefficients for 60 different renewable energy pathways based on the most likely conversion efficiencies (see Table 1) and after combining the input data from Tables 2 through 5. The four steps of the life cycle assessment (LCA) methodology [74] are followed in this study. Water as an inventory is analysed and the quantitative impacts are assessed and represented by water withdrawals and water consumption coefficients. The results of the water demand coefficients are assigned to the pathways for comparative assessment and an uncertainty analysis is conducted based on the variations of the conversion efficiency. Based on the complete life cycle of renewable energy pathways, biomass-based power generation has the most negative impact on water demand. This is because the complete life cycle includes the high water requirement in the agriculture stage. Power generation from the combustion of bio-oil produced from wood chip feedstock has the highest water demand coefficients; power generation from wind energy has the lowest.

When power generation is considered alone, the hydroelectricity pathway has the highest water consumption coefficient due to the large amount of water that evaporates in the reservoir. Due to

the nature of once-through cooling systems, the associated water withdrawals are generally large, and nuclear-based power generation with this cooling system technology has the highest water withdrawal coefficient. Despite the lower conversion efficiency of nuclear power plants, the steam cycle has a major part in this high water withdrawal coefficient. The cooling system also affects the water demand for power generation. In terms of the complete life cycle, the water consumption coefficient for nuclear energy through diffusion enrichment using a cooling tower (3.06 L/kWh) can be improved by 14% (2.64 L/kWh) if the cooling system is replaced by a cooling pond and can be improved further by 30% (1.84 L/kWh) if the pond is replaced by once-through cooling and by 33% (to 0.6 L/kWh) through dry cooling. This low coefficient (0.6 L/kWh) achieved through dry cooling is very close to the corresponding water consumption coefficient of a concentrating dish (0.63 L/kWh). The proper choice of a cooling system in this example during power generation compensates for the water consumption during the fuel cycle. The water consumption coefficients for the complete life cycle of coal-based and gas-fired power generation are in the range 0.96 – 3.21 L/kWh [23] and 0.07 – 2.57 [22], respectively. 24 of the 60 pathways for renewable energy developed in this study are within the range of the water consumption coefficients of coal-based power generation. Water consumption coefficients for all biomass pathways (1 through 32 in Table 6), pathway 41, pathway 44, pathway 47, and pathway 55 are higher than the water consumption coefficients for coal-based power generation. Water demand coefficients for geothermal flash technology and solar photovoltaic manufactured with thin film and operated through flat panels are very close to the corresponding minimum coefficients of gas-fired power generation. Water demand coefficients of nuclear power generation with cooling ponds are very close to the corresponding maximum water demand coefficients of gas-fired power generation.

5. Sensitivity analysis

The assumed conversion efficiencies detailed in Table 1 were used as inputs to ModelRisk [25] to study the impact of uncertainty in power plant performance on the water demand coefficients through Monte Carlo simulations. Figure 4 shows the probability percentile of each conversion efficiency considered for the base case compared to the maximum and minimum values.

Performance profiles are developed theoretically through equations to correlate conversion efficiency to water demand coefficients [23, 75]. The effect is studied separately for the two stages of primary fuel extraction or construction (upstream stage) and for the power generation stage.

5.1 Upstream stage

The distribution of WCUPs at probabilities of 10% and 90% is shown in Table 7 for pathways with different M1 and M2 values. The corresponding distribution of pathways with the same M1 and M2 values is shown in Table 8. When a pathway has the same M1 and M2 value, this indicates that the WWUP is the same as the WCUP, and no water is returned to the source. Wind energy takes the lead here, followed by geothermal, solar, and nuclear. Water demand coefficients for wind energy are always less than 0.15 L/kWh under all probability percentiles as shown from the output of the Monte Carlo simulation in Table 7. Water demand coefficients during the upstream stage are lower for these technologies due to the fact that either no fuel is required or very low water is needed, as in the case of nuclear power, and only materials and construction consume water.

The WWUPs for biomass upstream pathways are all assumed to be equal to the corresponding WCUPs ($M1=M2$). The intensive water used in the production stage of the biomass feedstock gives them the highest WCUPs of all the renewable energy pathways.

5.2 Power generation stage

Table 9 shows the water demand coefficients for the power generation stage at probability percentiles of 10% and 90%, besides the factors of merit. Of all the renewable energy technologies, wind energy still has the lowest water demand coefficients during power generation. Nuclear energy with a once-through cooling system has the highest impact on water withdrawals during the power generation stage (165.30 and 192.10 L/kWh at 10% and 90% probabilities, respectively). Biomass pathways outperform in water demand coefficients during the power generation stage compared to nuclear energy pathways.

Factors of merit are useful comparison tools for pathways following the same track. For example, the biomass power generation stage with a cooling tower has an M3 of 1.08 L/kWh while the same pathway based on nuclear energy has an M3 of 1.34 L/kWh, which indicates that at the same conversion efficiency, this biomass pathway always performs better than the corresponding nuclear pathway.

6. Conclusions

Sixty pathways of power generation from renewable energy were developed along with water demand coefficients for each pathway to cover water consumption and water withdrawals coefficients at the base case conversion efficiency. The effects of conversion efficiency variation on the water demand coefficients were studied through a comprehensive uncertainty analysis. Wind energy has the most positive impact on water demand and can alleviate the intensive water required to generate power. The highest water withdrawals coefficient during the power generation stage is from nuclear energy with a once-through cooling system and is 165.30 at a probability of 90% and 192.10 L/kWh at a probability of 10%. Direct combustion of corn stover has the lowest water demand coefficient (about 260 L/kWh for consumption and 260 – 387 L/kWh for withdrawals) among all the biomass pathways. The water required to irrigate crops grown for biomass negatively affects the water demand for biomass technology pathways. Considering the complete life cycle, dry cooling during power generation that can effectively compensate for the intensive water use during the fuel cycle. The lower conversion efficiencies of nuclear energy and solar-thermal pathways compared to other thermoelectric technologies negatively impacts the water demand coefficients. Improving conversion efficiency is one of the essential factors to consider when studying the level of water demand for a certain technology. The mostly likely conversion efficiencies selected for the base case in this study had the probability range of 33% - 72% based on the maximum and minimum ranges. Studies of water demand for power generation technologies have to be integrated with other environmental, economic, and social aspects in order to make decisions for sustainable development.

Acknowledgements

The authors are thankful to the NSERC/Cenovus/Alberta Innovates Associate Industrial Research Chair in Energy and Environmental Systems Engineering and the Cenovus Energy Endowed Chair in Environmental Engineering at the University of Alberta for financial support for this research. The authors would also like to thank Ms. Astrid Blodgett for editing the paper.

References

- [1]. Ifaei P, Rashidi J, Yoo CK. Thermoeconomic and environmental analyses of a low water consumption combined steam power plant and refrigeration chillers – Part 1: Energy and economic modelling and analysis. *Energy Conversion and Management* 2016; 123: 610–624.
- [2]. Krajacic G, Duic N, Rosen MA. Sustainable development of energy, water and environment systems. *Energy Conversion and Management* 2015; 104: 1–7.
- [3]. The International Renewable Energy Agency (IRENA). Renewable energy in the water, energy & food nexus. Available at: http://www.irena.org/DocumentDownloads/Publications/IRENA_Water_Energy_Food_Nexus_2015.pdf [accessed 01.04.2017].
- [4]. National Energy Technology Laboratory (NETL). Impact of drought on U.S. steam electric power plant cooling water intakes and related water resource management issues. DOE/NETL-2009/1364. Pittsburgh, PA. Available at: <https://www.netl.doe.gov/File%20Library/Research/Coal/ewr/water/final-drought-impacts.pdf> [accessed: 01.04.2017].
- [5]. Krajacic G, Duic N, Vujanovic M, Kilkis S, Rosen MA, Al-Nimr MA. Sustainable development of energy, water and environment systems for future energy technologies and concepts. *Energy Conversion and Management* 2016; 125: 1–14.
- [6]. U.S. Energy Information Administration (EIA). Annual energy outlook 2015 with projections to 2040. DOE/EIA-0383(2015). Available at: [http://www.eia.gov/forecasts/aeo/pdf/0383\(2015\).pdf](http://www.eia.gov/forecasts/aeo/pdf/0383(2015).pdf) [accessed: 01.04.2017].
- [7]. Chen Y, He L, Guan Y, Lu H, Li J. Life cycle assessment of greenhouse gas emissions and water-energy optimization for shale gas supply chain planning based on multi-level approach: Case study in Barnett, Marcellus, Fayetteville, and Haynesville shales. *Energy Conversion and Management* 2017; 134: 382–398.
- [8]. Macknick J. Water impacts of the electricity sector. American Solar Energy Society, World Renewable Energy Forum. National Renewable Energy Laboratory (NREL). Available at: <http://www.nrel.gov/docs/fy12osti/55028.pdf> [accessed: 01.04.2017].

- [9]. Statistics Canada. Section 3: the demand for water in Canada. Available at: <http://www.statcan.gc.ca/pub/16-201-x/2010000/part-partie3-eng.htm> [accessed: 01.01.2017].
- [10]. Hondo H. Life cycle GHG emission analysis of power generation systems: Japanese case. *Energy* 2005; 30: 2042–2056.
- [11]. World Nuclear Association (WNA). Comparison of lifecycle greenhouse gas emissions of various electricity generation sources. Available at: http://www.world-nuclear.org/uploadedFiles/org/WNA/Publications/Working_Group_Reports/comparison_of_lifecycle.pdf [accessed: 01.04.2017].
- [12]. Spath PL, Mann MK. Biomass power and conventional fossil systems with and without CO₂ sequestration – comparing the energy balance, greenhouse gas emissions and economics. Prepared under Task No. BB04.4010. NREL/TP-510-32575. Available at: <http://www.nrel.gov/docs/fy04osti/32575.pdf> [accessed: 01.04.2017].
- [13]. Lechon Y, Rua C, Saez R. Life cycle environmental impacts of electricity production by solarthermal power plants in Spain. *Journal of Solar Energy Engineering* 2008; 130: 021012-1-7.
- [14]. Goldstein R, Smith W. *Water & sustainability (Volume 3): U.S. water consumption for power production—The Next Half Century*. Palo Alto, CA: EPRI;1006786. Available at: <http://www.circleofblue.org/wp-content/uploads/2010/08/EPRI-Volume-3.pdf> [accessed 01.04.2017].
- [15]. Meldrum J, Anderson SN, Heath G, Macknick, J. Life cycle water use for electricity generation: a review and harmonization of literature estimates. *Environmental Research Letters* 2013; 8: 015031 (18pp).
- [16]. Fthenakis V, Kim HC. Life-cycle uses of water in U.S. electricity generation. *Renewable and Sustainable Energy Reviews* 2010; 14: 2039–2048.
- [17]. Wilson W, Leipzig T, Sattenspiel BG. Burning our rivers: the water footprint of electricity. A River Network Report Rivers, Energy & Climate Program. Available at: <http://climateandcapitalism.com/wp-content/uploads/sites/2/2012/06/Burning-Our-Water.pdf> [accessed: 01.04.2017].
- [18]. Singh S, Kumar A, Ali B. Integration of energy and water consumption factors for biomass conversion pathways. *Biofuels, Bioproducts and Biorefining* 2011; 5(4): 399-409.
- [19]. Gleick PH. Water and Energy. *Annual Review of Energy and Environment* 1994; 19:267–299.

- [20]. Webber ME. The water intensity of the transitional hydrogen economy. *Environmental Research Letters* 2007; 2: 034007 (7pp).
- [21]. Onat N, Bayar H. The sustainability indicators of power production systems. *Renewable and Sustainable Energy Reviews* 2010; 14: 3108–3115.
- [22]. Ali B, Kumar A. Development of life cycle water footprints for gas-fired power generation technologies. *Energy Conversion and Management* 2016; 110: 386–396.
- [23]. Ali B, Kumar A. Development of life cycle water-demand coefficients for coal-based power generation technologies. *Energy Conversion and Management* 2015; 90: 247–260.
- [24]. Tan C, Zhi Q. The energy-water nexus: a literature review of the dependence of energy on water. *Energy Procedia* 2016; 88: 277 – 284.
- [25]. ModelRisk Software. Software systems for quantitative risk analysis and management. Available at: <http://www.vosesoftware.com/> [accessed: 10.11.2016].
- [26]. Williams SK, Acker T, Goldberg M, Greve M. Estimating the economic benefits of wind energy projects using Monte Carlo simulation with economic input/output analysis. *Wind Energy* 2008; 11 (4): 397 – 414.
- [27]. Kullapa S, Marriott J. Increasing innovation in home energy efficiency: Monte Carlo simulation of potential improvements. *Energy and Buildings* 2010; 42 (6): 828 – 833.
- [28]. Karfopoulos KL, Anagnostakis MJ. Parameters affecting full energy peak efficiency determination during Monte Carlo simulation. *Applied Radiation and Isotopes* 2010; 68: 1435-1437.
- [29]. World Nuclear Association (WNA). Cooling power plants. Available at: <http://www.world-nuclear.org/info/Current-and-Future-Generation/Cooling-Power-Plants/> [accessed: 01.04.2017].
- [30]. Union of Concerned Scientists. How it works: water for power plant cooling. Available at: http://www.ucsusa.org/clean_energy/our-energy-choices/energy-and-water-use/water-energy-electricity-cooling-power-plant.html#.VjmMPvldVMQ [accessed: 01.04.2017].
- [31]. Singh S, Kumar A. Development of water requirement factors for biomass conversion pathways. *Bioresource Technology* 2011; 102(2), 1316-1328.
- [32]. Garcia SG, Lacoste C, Aicher T, Feijoo G, Lijo, L, Moreira MT. Environmental sustainability of bark valorisation into biofoam and syngas. *Journal of Cleaner Production* 2016; 125: 33-43.

- [33]. Fogarasi S, Cormos CC. Technico-economic assessment of coal and sawdust co-firing power generation with CO₂ capture. *Journal of Cleaner Production* 2015; 103: 140-148.
- [34]. Cohen BL. Breeder reactors: a renewable energy source. *American Journal of Physics* 1983; 51(1). Available at: <http://large.stanford.edu/publications/power/references/docs/pad11983cohen.pdf> [accessed: 01.04.2017].
- [35]. United States Nuclear Regulatory Commission (U.S.NRC). Uranium enrichment. Available at: <http://www.nrc.gov/docs/ML0313/ML031330159.pdf> [accessed: 01.04.2017].
- [36]. World Nuclear Association (WNA). Uranium enrichment. Available at: <http://www.world-nuclear.org/information-library/nuclear-fuel-cycle/conversion-enrichment-and-fabrication/uranium-enrichment.aspx> [accessed: 01.04.2017].
- [37]. Kim HJ, Lim SY, Yoo SH. Is the Korean public willing to pay for a decentralized generation source? The case of natural gas-based combined heat and power. *Energy Policy* 2017; 125-131.
- [38]. U.S. Department of Energy (DOE). Concentrating solar power commercial application study: reducing water consumption of concentrating solar power electricity generation. Report to Congress. Available at: http://www1.eere.energy.gov/solar/pdfs/csp_water_study.pdf [accessed: 01.04.2017].
- [39]. A.T. Kearney Inc. Solar thermal electricity 2025. Clean electricity on demand: attractive STE cost stabilize energy production. June 2010. Available at: <http://www.promes.cnrs.fr/uploads/pdfs/documentation/2010-Solar%20thermal%20electricity%202025%20ESTELA.pdf> [accessed: 01.11.2017].
- [40]. International Energy Agency (IEA). Technology roadmap: solar thermal electricity. Available at: https://www.iea.org/publications/freepublications/publication/technologyroadmapsolarthermalelectricity_2014edition.pdf [accessed 01.04.2017].
- [41]. Ali B. Simulation of a solar concentrating dish for steam generation. *International Journal of Sustainable Energy* 2003; 23 (3):129-141.
- [42]. Zhang HL, Baeyens J, Degreve J, Caceres G. Concentrated solar power plants: Review and design methodology. *Renewable and Sustainable Energy Reviews* 2013; 22: 466-481.

- [43]. Raugei M, Bargigli S, Ulgiati S. Life cycle assessment and energy pay-back time of advanced photovoltaic modules: CdTe and CIS compared to poly-Si. *Energy* 2007; 32:1310–1318.
- [44]. Peng J, Lu L, Yang H. Review on life cycle assessment of energy payback and greenhouse gas emission of solar photovoltaic systems. *Renewable and Sustainable Energy Reviews* 2013; 19: 255–274.
- [45]. Zhang HL, Gerven TV, Baeyens J, Degreve J. Photovoltaics: reviewing the European feed-in-tariffs and changing PV efficiencies and costs. *The Scientific World Journal* 2014; Volume 2014, Article ID 404913, 10 pages.
- [46]. U.S. Department of Energy (DOE). Small wind electric systems: a U.S. consumer’s guide. *Energy Efficiency and Renewable Energy*. Available at: <http://www.nrel.gov/docs/fy07osti/42005.pdf> [accessed: 01.04.2017].
- [47]. Weis T, Doukas A, Anderson K, Howell G. Landowners’ guide to wind energy in Alberta. Pembina Institute. Available at: <http://www.pembina.org/reports/alberta-landowners-guide-wind.pdf> [accessed: 01.04.2017].
- [48]. U.S. Department of Energy (DOE). 20% wind energy by 2030: increasing wind energy’s contribution to U.S. electricity supply. DOE/GO-102008-2567. Available at: <http://www.nrel.gov/docs/fy08osti/41869.pdf> [accessed: 01.04.2017].
- [49]. Ursavas E. A benders decomposition approach for solving the offshore wind farm installation planning at the North Sea. *European Journal of Operational Research* 2017; 258 (2): 703-714.
- [50]. Renewable Energy Policy Network for the 21st. Century (REN21). *Renewables 2016: global status report*. Available at: http://www.ren21.net/wp-content/uploads/2016/06/GSR_2016_Full_Report.pdf [accessed: 01.04.2017].
- [51]. U.S. Department of the Interior, Bureau of Reclamation (USBR). *Hydroelectric power*. Available at: <https://www.usbr.gov/power/edu/pamphlet.pdf> [accessed: 01.04.2017].
- [52]. International Energy Agency (IEA). *Key electricity trends: excerpt from: electricity information*. Available at: <http://www.iea.org/publications/freepublications/publication/KeyElectricityTrends.pdf> [accessed 01.04.2017].

- [53]. Younas U, Khan B, Ali SM, Arshad CM, Farid U, Zeb K, Rehman F, Mehmood Y, Vaccaro A. Pakistan geothermal renewable energy potential for electric power generation: a survey. *Renewable and Sustainable Energy Reviews* 2016; 63: 398–413.
- [54]. Kagel A, Bates D, Gawell K. A guide to geothermal energy and the environment. Geothermal Energy Association. Available at: <http://geo-energy.org/reports/environmental%20guide.pdf> [accessed: 01.04.2017]
- [55]. Ahmed I, Rashid A. Study of geothermal energy resources of Pakistan for electric power generation. *Energy Sources* 2010; Part A, 32:826–838.
- [56]. Ezzat MF, Dincer I. Energy and exergy analyses of a new geothermal–solar energy based system. *Solar Energy* 2016; 134: 95–106.
- [57]. Massachusetts Institute of Technology (MIT). The future of geothermal energy: impact of enhanced geothermal systems (EGS) on the United States in the 21st century. Available at: http://geothermal.inel.gov/publications/future_of_geothermal_energy.pdf [accessed: 01.04.2017].
- [58]. Bertani R. Geothermal power generation in the world 2010-2014 update report. Proceedings World Geothermal Congress 2015, Melbourne, Australia, 19-25 April 2015. Available at: <https://pangea.stanford.edu/ERE/db/WGC/papers/WGC/2015/01001.pdf> [accessed: 01.04.2017].
- [59]. Oel PRO, Hoekstra AY. Towards quantification of the water footprint of paper: a first estimate of its consumptive component. *Water Resources Management* 2012; 26:733–749.
- [60]. The Engineering ToolBox. Wood densities. Available at: http://www.engineeringtoolbox.com/wood-density-d_40.html [accessed: 01.04.2017].
- [61]. Ringer M, Putsche V, Scahill J. Large-scale pyrolysis oil production: a technology assessment and economic analysis. Technical Report NREL/TP-510-37779. Available at: <http://www.nrel.gov/docs/fy07osti/37779.pdf> [accessed: 01.04.2017].
- [62]. Boundy B, Diegel SW, Wright L, Davis SC. Biomass energy data book: edition 4. U.S Department of Energy (DOE), ORNL/TM-2011/446. Available at: <http://info.ornl.gov/sites/publications/files/Pub33120.pdf> [accessed: 01.04.2017].
- [63]. Warner ES, Heath GA. Life cycle greenhouse gas emissions of nuclear electricity generation: systematic review and harmonization. *Journal of Industrial Ecology* 2012; 16 (No.S1):S73:S92. DOI: 10.1111/j.1530-9290.2012.00472.x.

- [64]. National Energy Technology Laboratory (NETL). Assessment of parabolic trough and power tower solar technology cost and performance forecasts. Sargent & Lundy LLC Consulting Group Chicago, Illinois. Available at: <http://www.nrel.gov/docs/fy04osti/34440.pdf> [accessed: 01.04.2017].
- [65]. Evans A, Strezov V, Evans TJ. Assessment of sustainability indicators for renewable energy technologies. *Renewable and Sustainable Energy Reviews* 2009; 13: 1082–1088.
- [66]. U.S. Energy Information Administration (EIA). Annual energy review 2011: alternatives for estimating energy consumption. Available at: <http://www.eia.gov/totalenergy/data/annual/pdf/sec17.pdf> [accessed: 01.04.2017].
- [67]. Eurelectric. Hydropower: supporting a power system in transition. Available at: <http://www.eurelectric.org/media/180752/hydropower-final-lr-2015-2120-0003-01-e.pdf> [accessed: 01.04.2017].
- [68]. Moon H, Zarrouk SJ. Efficiency of geothermal power plants: a worldwide review. New Zealand Geothermal Workshop 2012 Proceedings, 19 - 21 November 2012, Auckland, New Zealand. Available at: <http://www.geothermal-energy.org/pdf/IGAstandard/NZGW/2012/46654final00097.pdf> [accessed 01.04.2017].
- [69]. Bertani R. Level of typical efficiencies for electricity generation of geothermal plants. EGEC. Available at: <http://egec.info/wp-content/uploads/2011/08/12-TP-GEOELEC-Pisa-Bertani.pdf> [accessed 01.04.2017].
- [70]. DiPippo R. Ideal thermal efficiency for geothermal binary plants. *Geothermics* 2007; 36: 276–285.
- [71]. Lacirignola M, Blanc I. Environmental analysis of practical design options for enhanced geothermal systems (EGS) through life-cycle assessment. *Renewable Energy* 2013; 50: 901-914.
- [72]. Macknick J, Newmark R, Heath G, Hallett KC. Operational water consumption and withdrawals factors for electricity generating technologies: a review of existing literature. *Environmental Research Letters* 2012; 7: 045802-12.
- [73]. Torcellini P, Long N, Judkoff R. Consumptive water use for U.S. power production. Available at: <http://www.nrel.gov/docs/fy04osti/35190.pdf> [accessed: 01.04.2017].
- [74]. Garofalo P, D'Andrea L, Tomaiuolo M, Venezia A, Castrignano A. Environmental sustainability of agri-food supply chains in Italy: the case of the whole-peeled tomato production under life cycle assessment methodology. *Journal of Food Engineering* 2017; 200: 1-12.

[75]. Yang X, Dziegielewski B. Water use by thermoelectric power plants in the United States. *Journal of the American Water Resources Association (JAWRA)* 2007; 43(1):160-69. DOI: 10.1111/j.1752-1688.2007.00013.x.


Figure 1: Renewable energy pathways

C-Si is the photovoltaic panel made of Crystalline Silicon.

EGS is the enhanced geothermal system.

Hydroelectricity, wind, solar photovoltaic and solar concentrating dish are the pathways with no cooling systems.

Biomass, solar thermal and nuclear are the pathways with cooling systems.

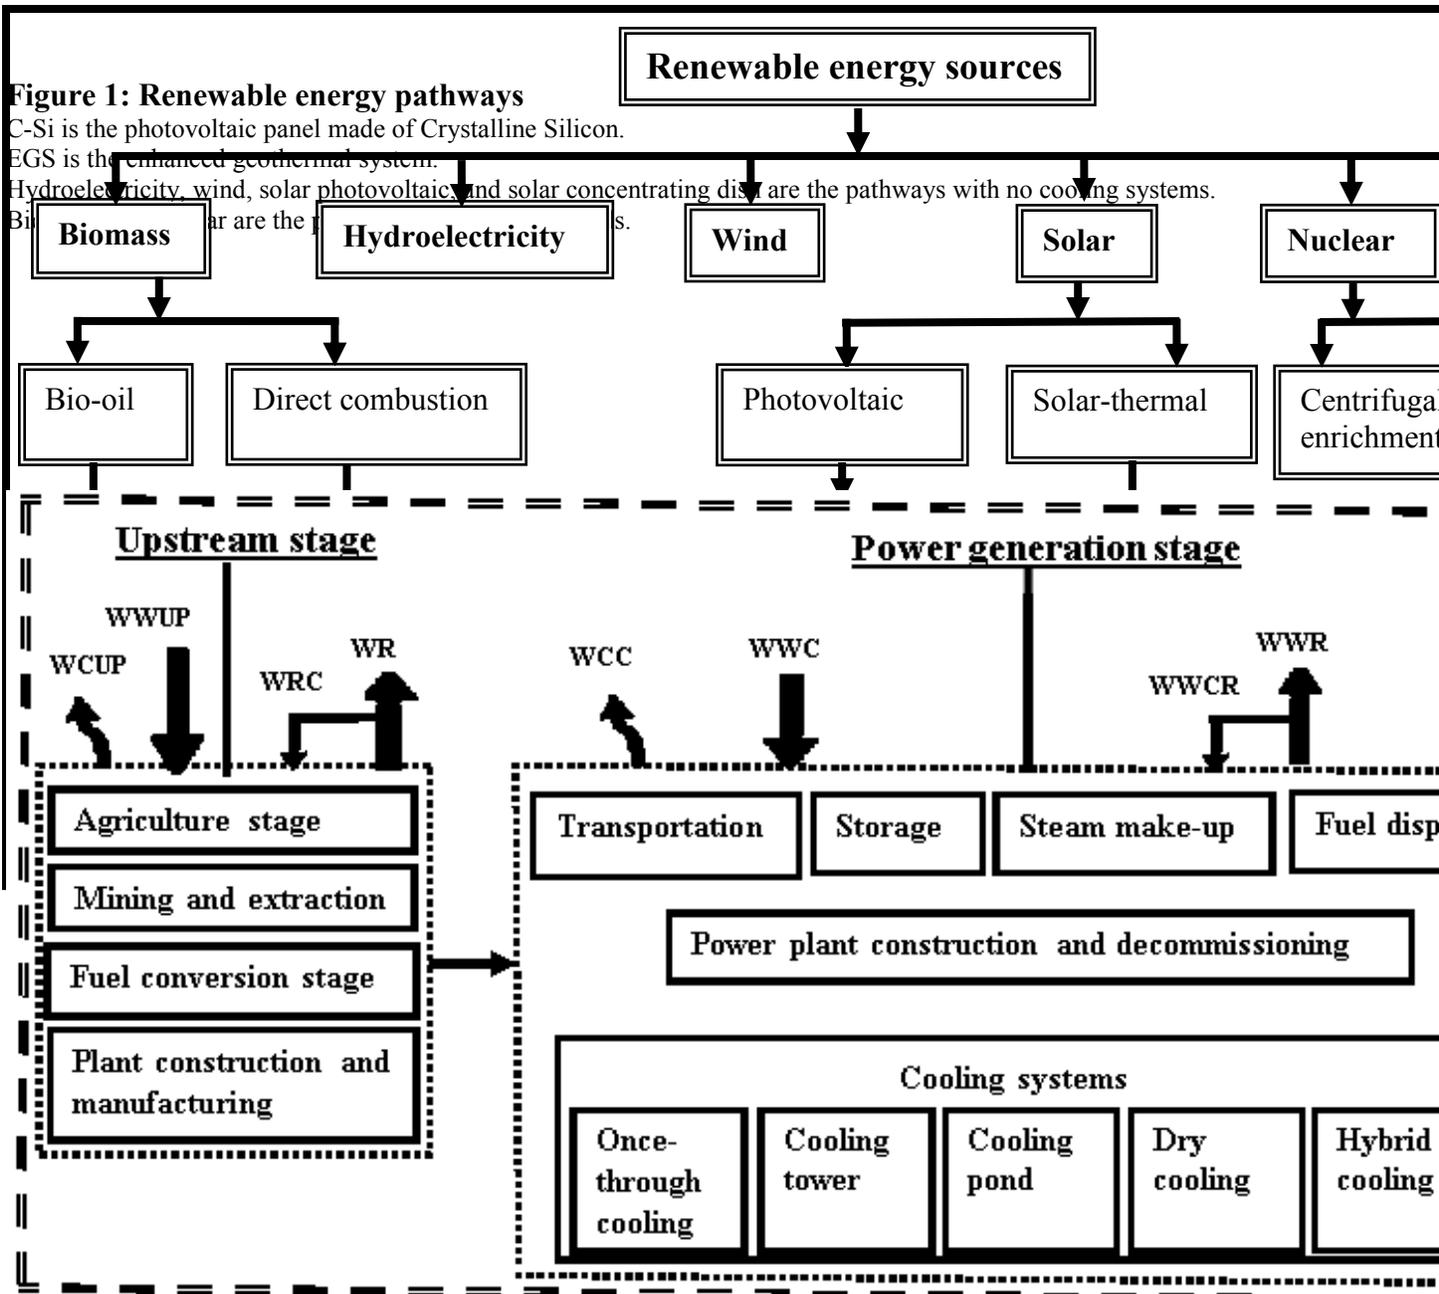

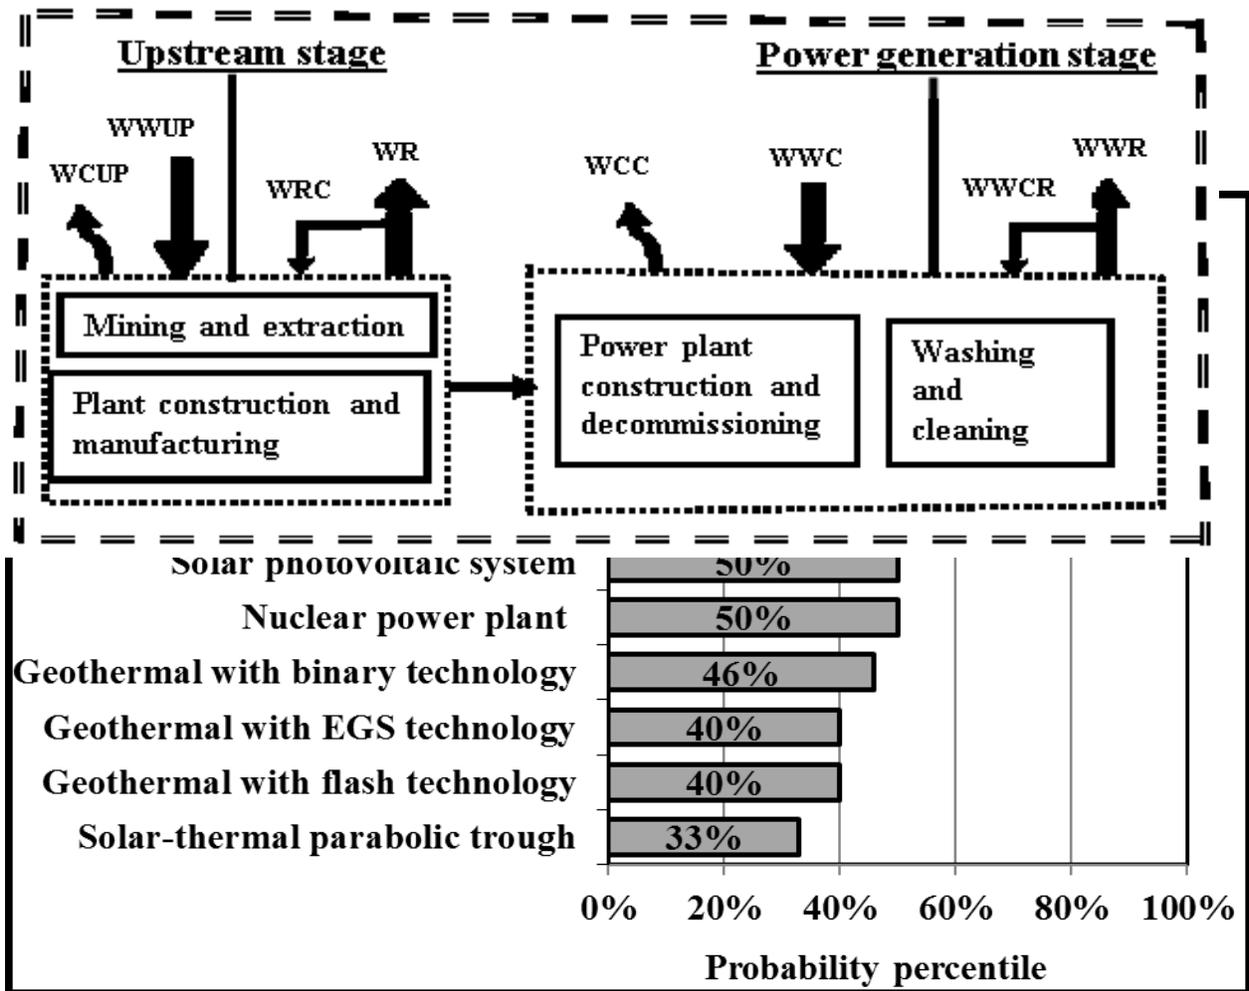


Figure 4: Probability percentiles of the most likely conversion efficiencies of renewable energy technologies

Table 1: Assumed conversion efficiencies of renewable energy technologies

Items	Minimum conversion efficiency (η_{\min})	Most likely conversion efficiency (η_{ml})	Maximum conversion efficiency (η_{\max})	Comments/Source
Biomass power plant	20%	33%	40%	According to the DOE, small capacity plants have low efficiency (20%) and with new techniques would reach over 40% [62]. η_{ml} is assumed based on a study by Singh et al. [18]. Direct combustion and bio-oil pathways were assumed to have the same range of conversion efficiency.
Nuclear power plant	30%	33%	36%	Based on the comprehensive review conducted by Warner and Heath [63] for nuclear power plants, which showed that boiler water reactors have lower efficiency than pressurized water reactors. η_{ml} is assumed as the average value.
Solar-thermal power tower	7%	20%	25%	η_{\min} is based on historical data [64], η_{ml} on the review by Meldrum et al. [15], and η_{\max} on the expected improvement of the technology after 2025 [39].
Solar-thermal parabolic trough	10%	15%	25%	
Solar-thermal Fresnel lens	10%	11%	25%	Based on under-construction plants and expected technology improvement after 2025 [39].
Solar-thermal concentrating dish	15%	22%	25%	
Solar photovoltaic system	4%	13%	22%	η_{\min} and η_{\max} are taken from a study assessing sustainability indicators
Wind power plant	24%	39%	54%	

				[65], and the average value is considered for η_{ml} .
Hydroelectricity power plant	82%	90%	98%	η_{ml} is considered according to [65, 66] and η_{min} , η_{max} were respectively assumed -8% and +8% compared to η_{ml} . η_{max} is extended from 95% [67] to 98% to accommodate for the expected technology improvement [52].
Geothermal with binary technology	1%	8%	16.3%	η_{min} is the actual efficiency of the Chena Hot Springs power plant with an average operation temperature 73°C [68]. η_{ml} is based on a power plant with an operating temperature of 180°C [69]. η_{max} is based on the upper end efficiency of a Miravalles Unit 5 power plant in Costa Rica [70].
Geothermal with flash technology	5%	11%	20%	η_{min} and η_{max} are based on the correlations developed by Moon and Zarrouk [68] and η_{ml} on a power plant operating at 180 °C [69].
Geothermal with EGS technology	7%	9%	12%	η_{ml} is based on the average from global efficiency ranges of 7.4%-10.4% and η_{max} derived from ten case studies [71].

Table 2: Input data for water demand coefficients of biomass pathways

Pathway	Upstream	Power generation stage ^d	
---------	----------	-------------------------------------	--

	stage	Once-through cooling		Cooling tower		Cooling pond		Dry cooling	
	WCUP/ WWUP (L/kWh)	WCC (L/kWh)	WWC (L/kWh)	WC C (L/kWh)	WW C (L/kWh)	WC C (L/kWh)	WWC (L/kWh)	WC C (L/kWh)	WWC (L/kWh)
Wood chips-Direct combustion	622.45 ^a	1.36	127.34	2.20	2.53	2.13	2.55	0.22	0.25
Wood chips-Bio-oil	1161.81 ^b								
Corn stover-Direct combustion	259.38 ^c								
Corn stover-Bio-oil	326.59 ^c								
Wheat straw-Direct combustion	318.30 ^c								
Wheat straw-Bio-oil	465.80 ^c								
Switchgrass-Direct combustion	672.13 ^c								
Switchgrass-Bio-oil	823.67 ^c								

^a Estimated water footprint for Canadian pine = 1.141 m³ of water per kg of wood [59, 60] with 20 MJ/kg HHV for wood [61], and conversion efficiency (η_{ml}) 33%.

^b Estimated water footprint for Canadian pine = 1.141 m³ of water per kg of wood [59, 60] with 17.9 MJ/kg HHV for bio-oil; the yield is 0.599 kg of bio-oil per kg of dry wood [61] and conversion efficiency (η_{ml}) of 33%.

^c Based on water consumption coefficients developed in Singh et al. [18].

^d Subcritical water demand coefficients developed earlier (at a conversion efficiency of 35%) [23] were used to estimate these coefficients through Equation 3.

Table 3: Input data for water demand coefficients of nuclear pathways^a

Pathway	Upstream stage	Power generation stage							
		Once-through cooling		Cooling tower		Cooling pond		Dry cooling	
	WCUP/ WWUP (L/kWh)	WCC (L/kWh)	WWC (L/kWh)	WC C (L/kWh)	WW C (L/kWh)	WC C (L/kWh)	WW C (L/kWh)	WCC (L/kWh)	WWC (L/kWh)
Nuclear-Centrifugal enrichment	0.21	1.52	178.03	2.73	4.17	2.31	4.17	0.27	0.42
Nuclear-Diffusion enrichment	0.33/0.53								

^a Coefficients were based on the median values of statistics revision from the literature [15] and assumed at the same conversion efficiency (η_{ml}) of 33%.

Table 4: Input data for water demand coefficients of solar-thermal and geothermal pathways^a

Pathway	Upstream stage	Power generation stage					
		Cooling tower		Hybrid cooling		Dry cooling	
	WCUP/ WWUP (L/kWh)	WCC (L/kWh)	WWC (L/kWh)	WCC (L/kWh)	WWC (L/kWh)	WCC (L/kWh)	WWC (L/kWh)
Solar-thermal-Power tower	0.61	3.07	3.07	0.64	0.64	0.10	0.10
Solar-thermal-Parabolic trough	0.61	3.37	3.64	1.29	1.29	0.30	0.30
Solar-thermal-Fresnel	0.61	3.79 ^b	3.79 ^b	-	-	0.38 ^c	0.38 ^c
Solar-thermal-Concentrating dish	0.61	0.02 ^d					
Geothermal-Binary	0.01	-	-	1.74	1.74	1.10	1.10
Geothermal-Flash	0.01	0.06 ^b	0.06 ^b	-	-	-	-
Geothermal-EGS	0.01	-	-	-	-	1.93	1.93

^a Coefficients were based on the median values of statistics revision from the literature [15] and assumed at the same conversion efficiency η_{ml} detailed in Table 1.

^b Assumed with a cooling tower of equal consumption and withdrawals coefficients [72].

^c Estimated with the assumption of 10% from the associated cooling tower coefficients.

^d No cooling system is needed and coefficients were assumed for other water uses such as washing.

Table 5: Input data for water demand coefficients of photovoltaic, wind, and hydroelectricity pathways^a

Pathway	Upstream stage		Power generation stage			
			Flat panel		Concentrated PV	
	WCU P (L/kWh)	W WU P (L/ kWh)	WCC (L/k Wh)	WWC (L/k Wh)	WCC (L/kWh)	WWC (L/kWh)
Crystalline silicone	0.31	0.36	0.02	0.02	0.11	0.11
Thin film	0.02	0.07				
	WCUP (L/kWh)	WWU P (L/k Wh)	WCC (L/kWh)	WWC (L/kWh)		
Wind	3.8×10^{-4}	0.098	0.0049	0.0057		
Hydroelectricity ^b	0.00	0.00	68.18	68.18		

^a Coefficients were based on the median values of statistics revision from the literature [15] and assumed at the same conversion efficiency η_{ml} detailed in Table 1.

^b Water demand coefficients were developed considering the national average rate of evaporation from reservoirs in the U.S [73]. Upstream water demand coefficients were not considered.

Table 6: Base case water demand coefficients for power generation from renewable energy pathways

NO.	Pathway	Complete life cycle	
		Water Consumption coefficient (L/kWh)	Water Withdrawals coefficient (L/kWh)
1	Biomass-Wood chips-Direct combustion-Once-through cooling	623.81	749.79
2	Biomass-Wood chips-Direct combustion-Cooling tower	624.65	624.98
3	Biomass-Wood chips-Direct combustion-Cooling pond	624.58	625.00
4	Biomass-Wood chips-Direct combustion-Dry cooling	622.67	622.70
5	Biomass-Wood chips-Bio-oil-Once-through cooling	1163.17	1289.15
6	Biomass-Wood chips-Bio-oil-Cooling tower	1164.01	1164.34
7	Biomass-Wood chips-Bio-oil-Cooling pond	1163.94	1164.36
8	Biomass-Wood chips-Bio-oil-Dry cooling	1162.03	1162.06
9	Biomass-Corn stover-Direct combustion-Once-through cooling	260.74	386.72
10	Biomass-Corn stover-Direct combustion-Cooling tower	261.58	261.91
11	Biomass-Corn stover-Direct combustion-Cooling pond	261.51	261.93
12	Biomass-Corn stover-Direct combustion-Dry cooling	259.60	259.63
13	Biomass-Corn stover-Bio-oil-Once-through cooling	327.92	453.90
14	Biomass-Corn stover-Bio-oil-Cooling tower	328.76	329.09
15	Biomass-Corn stover-Bio-oil-Cooling pond	328.69	329.11
16	Biomass-Corn stover-Bio-oil-Dry cooling	326.78	326.81
17	Biomass-Wheat straw-Direct combustion-Once-through cooling	319.66	445.64

18	Biomass-Wheat straw-Direct combustion-Cooling tower	320.50	320.83
19	Biomass-Wheat straw-Direct combustion-Cooling pond	320.43	320.85
20	Biomass-Wheat straw-Direct combustion-Dry cooling	318.52	318.55
21	Biomass-Wheat straw-Bio-oil-Once-through cooling	467.16	593.14
22	Biomass-Wheat straw-Bio-oil-Cooling tower	468.00	468.33
23	Biomass-Wheat straw-Bio-oil-Cooling pond	467.93	468.35
24	Biomass-Wheat straw-Bio-oil-Dry cooling	466.02	466.05
25	Biomass-Switchgrass-Direct combustion-Once-through cooling	673.49	799.47
26	Biomass-Switchgrass-Direct combustion-Cooling tower	674.33	674.66
27	Biomass-Switchgrass-Direct combustion-Cooling pond	674.26	674.68
28	Biomass-Switchgrass-Direct combustion-Dry cooling	672.35	672.38
29	Biomass-Switchgrass-Bio-oil-Once-through cooling	825.03	951.01
30	Biomass-Switchgrass-Bio-oil-Cooling tower	825.87	826.20
31	Biomass-Switchgrass-Bio-oil-Cooling pond	825.80	826.22
32	Biomass-Switchgrass-Bio-oil-Dry cooling	823.89	823.92
33	Nuclear-Centrifugal enrichment-Once-through cooling	1.73	178.24
34	Nuclear-Centrifugal enrichment-Cooling tower	2.94	4.38
35	Nuclear-Centrifugal enrichment-Cooling pond	2.52	4.38
36	Nuclear-Centrifugal enrichment-Dry cooling	0.48	0.63
37	Nuclear-Diffusion enrichment-Once-through cooling	1.84	178.56
38	Nuclear-Diffusion enrichment-Cooling tower	3.06	4.70
39	Nuclear-Diffusion enrichment-Cooling pond	2.64	4.70
40	Nuclear-Diffusion enrichment-Dry cooling	0.60	0.95
41	Solar-thermal-Power tower-Cooling tower	3.67	3.67

42	Solar-thermal-Power tower-Hybrid cooling	1.25	1.25
43	Solar-thermal-Power tower-Dry cooling	0.70	0.70
44	Solar-thermal-Parabolic trough-Cooling tower	3.98	3.98
45	Solar-thermal-Parabolic trough-Hybrid cooling	1.89	1.89
46	Solar-thermal-Parabolic trough-Dry cooling	0.90	0.90
47	Solar-thermal-Fresnel-Cooling tower	4.39	4.39
48	Solar-thermal-Fresnel-Dry cooling	0.98	0.98
49	Solar-thermal-Concentrating dish	0.63	0.63
50	Solar-Photovoltaic-Crystalline Silicon (C-Si)-Flat paneled	0.33	0.38
51	Solar-Photovoltaic-Crystalline Silicon (C-Si)-Concentrated PV	0.42	0.47
52	Solar-Photovoltaic-Thin film-Flat paneled	0.05	0.09
53	Solar-Photovoltaic-Thin film-Concentrated PV	0.14	0.18
54	Wind	0.005	0.104
55	Hydroelectricity	68.182	68.182
56	Geothermal-Binary-Hybrid cooling	1.75	1.75
57	Geothermal-Binary-Dry cooling	1.11	1.11
58	Geothermal-Flash-Cooling tower	0.06	0.07
59	Geothermal-Flash-Dry cooling	0.05	0.08
60	Geothermal-Enhanced geothermal system (EGS)-Binary-Dry cooling	1.94	1.94

Table 7: WCUP and WWUP distributions for the upstream stage of renewable energy pathways with different values for M1 and M2

Pathway	Values (L/kWh) at a probability of 10% ^c		Values (L/kWh) at a probability of 90% ^c		Factor of M1 ^a (L/kWh)
	WCUP	WWUP	WCUP	WWUP	M1 ^a
Nuclear-Diffusion enrichment	0.35	0.56	0.31	0.50	0.11
Solar-Photovoltaic-C-Si	0.0032	0.58	0.0072	0.26	0.04
Solar-Photovoltaic-Thin film	0.037	0.11	0.016	0.049	0.003
Wind	0.00005	0.1251	0.00003	0.0812	0.00001

^a Calculated using Equation 1, the conversion efficiencies (η_{mi}) from Table 1, and the corresponding WCUPs from input tables (Tables 2 to 5).

^b Calculated using Equation 2, the conversion efficiencies (η_{mi}) from Table 1, and the corresponding WWUPs from input tables (Tables 2 to 5).

^c M1 and M2 were used with Equations 1 and 2, respectively, to calculate the WCUP and the WWUP using a Monte Carlo probability triangular distribution of conversion efficiency.

Table 8: WCUP and WWUP distributions for the upstream stage of renewable energy pathways with the same M1 and M2

Pathway	WCUP/WWUP (L/kWh) at a probability of 10%^b	WCUP/WWUP (L/kWh) at a probability of 90%^b	Factor of merit M1 = M2^a (L/kWh)
Nuclear-Centrifugal enrichment	0.22	0.20	0.07
Solar-thermal-Power tower	1.02	0.55	0.12
Solar-thermal-Parabolic trough	0.71	0.43	0.09
Solar-thermal-Fresnel	0.78	0.56	0.07
Solar-thermal-Concentrating dish	0.76	0.57	0.13
Geothermal-Binary	0.02	0.006	0.0008
Geothermal-Flash	0.01	0.007	0.0011
Geothermal-EGS	0.01	0.008	0.0009
Wood chips-Direct combustion	818.36	566.49	205.41
Wood chips-Bio-oil	1527.45	1057.36	383.40
Corn stover-Direct combustion	341.06	236.07	85.60
Corn stover-Bio-oil	429.38	297.23	107.77
Wheat straw-Direct combustion	418.49	289.69	105.04
Wheat straw-Bio-oil	612.41	423.92	153.71
Switchgrass-Direct combustion	883.68	611.70	221.80
Switchgrass-Bio-oil	1082.91	749.62	271.81

^a Calculated using Equation 1, the conversion efficiencies (η_{mi}) from Table 1, and the corresponding WCUPs from input tables (Tables 2 to 5).

^b M1 was used with Equation 1 to calculate the WCUP/WWUP using a Monte Carlo probability triangular distribution of conversion efficiency.

Table 9: WCUP and WWUP distributions for the power generation stage of renewable energy pathways

Pathway	WCC (L/kWh) at a probability of 10% ^e	WCC (L/kWh) at a probability of 90% ^e	WWC (L/kWh) at a probability of 10% ^f	WWC (L/kWh) at a probability of 90% ^f	Factor of	
					M3 ^a	M
Biomass-Once-through cooling	1.99	1.17	187.16	110.25	0.67	6
Biomass-Cooling tower	3.23	1.90	3.71	2.19	1.08	1
Biomass-Cooling pond	3.13	1.85	3.74	2.21	1.05	1
Biomass-Dry cooling	0.32	0.19	0.37	0.22	0.11	0
Nuclear-Once-through cooling	1.63	1.41	192.10	165.30	0.75	8
Nuclear-Cooling tower	2.94	2.53	4.50	3.87	1.34	2
Nuclear-Cooling pond	2.49	2.15	4.50	3.87	1.14	2
Nuclear-Dry cooling	0.29	0.25	0.45	0.39	0.13	0
Geothermal-Flash-Dry cooling	0.06	0.03	0.10	0.04	0.005	0
Solar-thermal-Power tower-Cooling tower	5.71	2.72	5.71	2.72	0.77	0
Solar-thermal-Power tower-Hybrid cooling	1.20	0.57	1.20	0.57	0.16	0
Solar-thermal-Power tower-Dry cooling	0.18	0.09	0.18	0.09	0.02	0
Solar-thermal-Parabolic trough-Cooling tower	4.07	2.22	4.07	2.22	0.59	0
Solar-thermal-Parabolic trough-Hybrid cooling	1.56	0.85	1.56	0.85	0.23	0
Solar-thermal-Parabolic trough-Dry cooling	0.36	0.19	0.36	0.19	0.05	0
Solar-thermal-Fresnel-Cooling tower	5.00	3.47	5.00	3.47	0.47	0
Solar-thermal-Fresnel-Dry cooling	0.50	0.35	0.50	0.35	0.05	0
Geothermal-Binary-Hybrid cooling	3.40	1.04	3.40	1.04	0.15	0
Geothermal-Binary-Dry cooling	2.14	0.65	2.14	0.65	0.10	0
Geothermal-Flash-Cooling tower	0.08	0.04	0.08	0.04	0.007	0
Geothermal-EGS-Binary-Dry cooling	2.20	1.58	2.20	1.58	0.19	0
Solar-thermal-Concentrating dish	0.02	0.018	0.02	0.018	-	
Solar-Photovoltaic-Flat paneled	0.04	0.02	0.04	0.02	-	
Solar-Photovoltaic-Concentrated PV	0.18	0.08	0.18	0.08	-	
Wind	0.006	0.004	0.007	0.005	-	

Hydroelectricity	71.70	65.00	71.70	65.00	-
------------------	-------	-------	-------	-------	---

^a Calculated using Equation 3, the conversion efficiencies (η_{ml}) from Table 1, and the corresponding WCCs from the input tables (Tables 2 to 5).

^b Calculated using Equation 4, the conversion efficiencies (η_{ml}) from Table 1, and the corresponding WCCs from the input tables (Tables 2 to 5).

^c Calculated using Equation 5, the conversion efficiencies (η_{ml}) from Table 1, and the corresponding WCCs from the input tables (Tables 2 to 5).

^d Calculated using Equation 6, the conversion efficiencies (η_{ml}) from Table 1, and the corresponding WCCs from the input tables (Tables 2 to 5).

^e M3 and M5 were used with Equations 3 and 5, respectively, to calculate the WCCs using a Monte Carlo probability triangular distribution of conversion efficiency.

^f M4 and M6 were used with Equations 4 and 6, respectively, to calculate the WCCs using a Monte Carlo probability triangular distribution of conversion efficiency.

Table 10: Nomenclature

°C	Celsius degree
CDS	cadmium sulfide
CDTe	cadmium telluride
C-Si	crystalline silicon
DOE	U.S. Department of Energy
EGS	enhanced geothermal system
EG-silicon	electronic silicon
g CO ₂ -eq/kWh	gram of CO ₂ equivalent per kWh of power generated
GHG	greenhouse gas emissions
GW	gigawatt, equals 10 ⁹ watts
HHV	higher heating value
LCA	life cycle assessment
L/kWh	litres of water per kWh of power generated
MG-silicon	metallurgical grade silicon
MJ/kg	mega-joule per kilogram
MW	megawatt, equals 10 ⁶ watts
M1	factor of merit in L/kWh for ranking water consumption of a renewable pathway during the upstream stage
M2	factor of merit in L/kWh for ranking water withdrawals of a renewable pathway during the upstream stage
M3	factor of merit in L/kWh for ranking water consumption of a renewable energy pathway using steam cycle during the power generation stage
M ³	cubic metre, a unit of volume in the metric system, equal to a volume of a cube with one metre edges
M4	factor of merit in L/kWh for ranking water withdrawals of a renewable energy pathway using steam cycle during the power generation stage
M5	factor of merit in L/kWh for ranking water consumption of a renewable energy pathway that does not use the steam cycle during the power generation stage

M6	factor of merit in L/kWh for ranking water withdrawals of a renewable energy pathway not using the steam cycle during the power generation stage
p-n	positive-negative junction
PV	photovoltaic
RET	renewable energy technology
U.S.	the United States
WCC	water consumption coefficient in L/kWh during the power generation stage
WCUP	water consumption coefficient in L/kWh during the upstream stage
WR	returned water coefficient in L/kWh during the upstream stage
WRC	recycled water coefficient in L/kWh during the upstream stage
WWC	water withdrawals coefficient in L/kWh during the power generation stage
WWCR	recycled water coefficient in L/kWh during the power generation stage
WWR	returned water coefficient in L/kWh during the power generation stage
WWUP	water withdrawals coefficient in L/kWh during the upstream stage
η	conversion efficiency of power generation from the renewable technology
η_{\max}	maximum conversion efficiency
η_{\min}	minimum conversion efficiency
η_{ml}	most likely conversion efficiency